




SECTION A-A

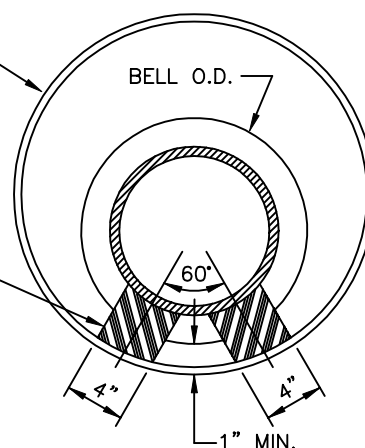

SECTION B-B

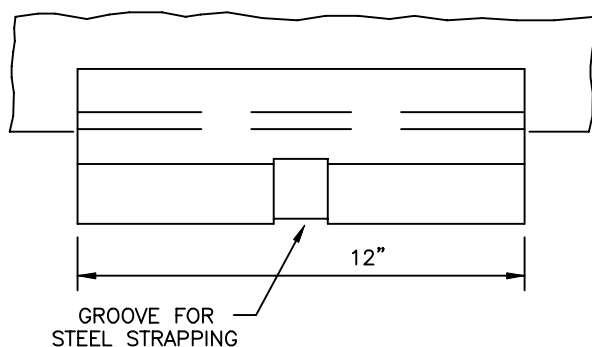

REDWOOD BLOCK DETAIL

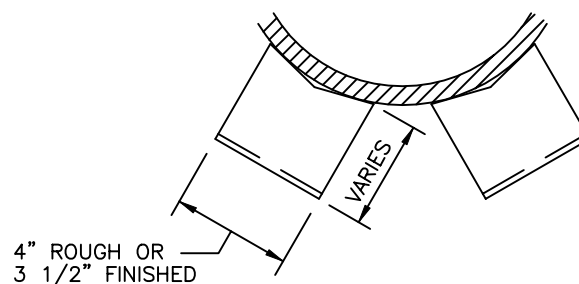

NOTES:

1. REDWOOD BLOCKS SHALL BE CONSTRUCTION GRADE.
2. REDWOOD BLOCKS SHALL BE VEED TO FIT CONTOUR OF PIPE.
3. WHEN JACKING CASING, GRADE SHALL BE SET SO CENTERLINE OF CASING SHALL COINCIDE WITH CENTERLINE OF WATER MAIN.
4. REDWOOD BLOCKS SHALL BE STRAPPED TO THE PIPE WITH STEEL STRAPPING OR APPROVED WIRE BANDS.
5. PLUG ENDS OF CASING WITH 12 INCHES MINIMUM OF CONCRETE.
6. CONCRETE SHALL BE CLASS B.